

# RISH Delta Energy / Demand (Multifunction instrument)

## Application:

**RISH Delta Energy** measures important electrical parameters in 3 phase 4 Wire and 3 phase 3 Wire Network & replaces the multiple analog panel meters. It measures electrical parameters like AC Voltage, AC Current, Frequency, Active, Reactive, Apparent Power, Import & Export Energy & many more.

## Salient Features:

- Fast & Easy Installation on panel with self clicking.
- True RMS measurement.
- MODBUS (Rs485) Communication (optional).
- Pulse/Limit Switch output (optional).
- 3 Line 4 Digits ultra bright LED Display (up to 9999).
- On site Programmable CT/PT Ratios.
- User selectable CT Secondary 1A/5A.
- User selectable PT Secondary from 100 VLL to 500 VLL.
- User selectable 3ph3wire / 3ph4wire / single phase Network.
- Programmable Energy format & Energy rollover count
- Wide auxiliary Power Supply which can accept any input between 40V – 300V AC/DC.
- Storage of MIN / MAX values.
- Measurement & Display of RPM, Run hours, On hours, No. of interruption.

## Products Features:

### On site programmable PT/CT ratios:

It is possible to program primary of external potential Transformer (PT), primary of external Current Transformer (CT) on site via front panel keys by entering into Programming mode.

### User selectable CT Secondary 5A/1A

The secondary of external Current Transformer (CT) can be programmed on site to either 5A or 1A using front panel keys.

### User selectable PT Secondary

The secondary of external Potential Transformer (PT) can be programmed on site from 100VLL to 500VLL using front panel keys. User can set the display in auto scrolling mode or fixed screen mode using front panel keys.

### Low back depth:

The instrument has very low back depth (behind the panel) of less than 55 mm (Without output option).

### Four function keys:

Using the four function key, it is possible to go desired parameter screen instantly..

### Demand Measurement

Measures & Displays Current Demand, kVA Demand, kW Import Demand, kW Export Demand. Any of the parameters can be assigned to optional Limit switch.



### True RMS measurement

The instrument measures distorted waveform up to 15th Harmonic.

### Energy Measurement (Import & Export):

Active Energy (kWh), Reactive Energy (kVArh), Apparent Energy (VAh). Any of the parameters can be assigned to optional Pulse output.

### Programmable Energy format & Energy rollover count:

Customer can assign the format for energy display on MODBUS (RS485) in terms of W, kW or MW. Additional to this, customer can also set a rollover count from 7 to 14 digits depending on the energy format, after which the energy will roll back to zero.

### Optional Pulse Output / Limit switch (Relay output):

The instrument can be programmed as Pulse output or Limit switch.

**Pulse Output :** The optional pulse output is a **potential free**, very fast acting relay contact which can be used to drive an external mechanical counter for energy measurement.

**Limit Switch :** The instrument will trip the relay if the programmed parameter exceeds the programmed Trip Limits.

### Optional MODBUS (RS485) Output:

The optional Modbus output enables the instrument to transmit all the measured parameters over standard MODBUS (Rs485).

### Configuration of Instrument via MODBUS :

The instrument setting can be configured locally via front panel keys by entering into the programming mode or remotely via MODBUS (Rs485).

**Note:** The MODBUS communication parameters can only be set locally via front panel keys in programming mode.

### Storage of parameters possible

The instrument stores minimum and maximum values for System Voltage, System Current, Run Hour, ON Hour & number of Interrupts. Every 60 sec stored values are updated.



**RISHABH INSTRUMENTS**  
Measure, Control & Record with a Difference

RISHABH INSTRUMENTS PVT.LTD.  
F-31, MIDC, Satpur, Nashik-422 007, India.  
Tel.: +91 253 2202160, 2202202 Fax : +91 253 2351064  
E-mail : India :- marketing@rishabh.co.in  
International :- exp.marketing@rishabh.co.in  
www.rishabh.co.in

# RISH Delta Energy / Demand (Multifunction instrument)

## 3 line 4 digits LED display:

Simultaneous display of 3 Parameters.

**RPM Measurement:** The instrument display Rotation per minutes for generator applications. Number of poles can be set on site depending upon application requirement.

## Energy Count Storage:

In case of power failure, the instrument memorizes the last energy count. Every 1 min, the instrument updates the energy counter in the non-volatile memory.

## User selectable 3 phase 3Wire or 4Wire or Single phase Network

User can program on site the network connection as either 3 Phase 3 Wire or 4 Wire or single phase network using front panel keys.

In case of self powered Rish Delta only either 3 Phase 4 wire or single phase network are available.

## Onsite selection of Auto scroll / Fixed Screen

User can set the display in auto scrolling mode or fixed screen mode using front panel keys.

## Enclosure Protection for dust and water:

Conforms to IP 50 (for front face) & IP 20 (for back)  
IP 65 (for front with seal) as per IEC60529.

## EMC Compatibility

Compliance to International standard IEC 61326.

- Interference Emission : IEC 61326-1 : 2005, Class A
- Interference Immunity : IEC 61326-1 : 2005
- Electrostatic discharge : IEC 61000-4-2 -- 4kV/8kV contact/air. (ESD)
- EM Field : IEC 61000-4-3 -- 10 V/m (80 MHz to 1 GHz)  
-- 3 V/m (1.4 Ghz to 2 GHz)  
-- 1 V/m (2 GHz to 2.7 GHz)
- Burst : IEC 61000-4-4 -- 2 kV (5/50 ns, 5 kHz)
- Surge : IEC 61000-4-5 -- 1 kVLL / 2 kVLN.
- Conducted RF : IEC 61000-4-5 -- 3 V (150 kHz to 80 MHz)
- Rated Power Frequency magnetic Field : IEC 61000-4-8 -- 30 A/m
- Voltage dip : IEC 61000-4-11 -- 0% during 1 cycle.  
-- 40% during 10/12 cycles.  
-- 70% during 25/30 cycles.
- Short interruptions : IEC 61000-4-11 -- 0% during 25/30 cycles.  
25 cycles for 50 Hz test.  
30 cycles for 60 Hz test.

## Technical Specifications:

Nominal input voltage (AC RMS)  
Max continuous input voltage  
Nominal input voltage burden  
System PT secondary values  
System PT primary values

### Input Voltage:

Phase –Neutral 290V L-N , Line-Line 500V L-L  
120% of rated value  
< 0.3 VA approx. per phase (For external auxiliary meter)  
100VLL to 500VLL programmable on site.  
100VLL to 692kVLL programmable on site.

### Input Current:

Nominal input current 5A / 1A AC RMS  
System CT secondary values 1A & 5A programmable on site.  
System CT primary values From 1A up to 9999A (for 1 or 5 Amp )  
Max continuous input current 120% of rated value  
Nominal input current burden < 0.2 VA approx. per phase

### Auxiliary Supply:

External Aux 40 V – 300V AC-DC (± 5 % )  
Self powered input voltage range from 80% to 100% of Rated value.  
(Self powered meter is available only in 3Phase 4 Wire and Single Phase network.)  
Auxiliary input is derived from Phase 1 (R phase)  
Frequency range 45 to 65 Hz  
VA burden < 4 VA Approx.

### Overload Withstand:

Voltage 2 x rated value for 1 second, repeated 10 times at 10 second intervals  
Current 20x rated value for 1 second, repeated 5 times at 5 min intervals



**RISHABH**  
INSTRUMENTS  
Measure, Control & Record with a Difference

RISHABH INSTRUMENTS PVT.LTD.  
F-31, MIDC, Satpur, Nashik-422 007, India.  
Tel.: +91 253 2202160, 2202202 Fax : +91 253 2351064  
E-mail : India :- marketing@rishabh.co.in  
International :- exp.marketing@rishabh.co.in  
www.rishabh.co.in

# RISH Delta Energy / Demand (Multifunction instrument)

## Technical Specifications:

### Operating Measuring Ranges:

Voltage Range With External Aux	10... 120% of rated value
Voltage Range With Self Power	80... 120% of rated value
Current Range	10 ... 120% of rated value
Frequency	45...65 Hz.
Power Factor	0.5 Lead ... 1 ... 0.5 Lag.

### Reference conditions for Accuracy:

Reference temperature	23°C +/- 2°C
Input waveform	Sinusoidal (distortion factor 0.005)
Input frequency	50 or 60 Hz ±2%
Auxiliary supply voltage	Rated Value ±1%
Auxiliary supply frequency	Rated Value ±1%
Voltage Range	20... 100% of Nominal Value.
Current Range	10... 100% of Nominal Value.
Power	Cos phi / sin phi = 1 for Active / Reactive Power & Energy. 10... 100% of Nominal Current & 20... 100% of Nominal Voltage.
Power Factor / Phase Angle	40... 100% of Nominal Current & 20... 100% of Nominal Voltage.

### Accuracy:

Voltage	±1.0% of Nominal Value.
Current	±1.0% of Nominal Value.
Frequency	0.5% of mid frequency
Active Power	±1% of Nominal Value.
Re-Active Power	±1% of Nominal Value.
Apparent Power	±1% of Nominal Value.
Active Energy	± 1 %
Reactive Energy	± 1 %
Apparent Energy	± 1 %
Power Factor	2 % of Unity
Phase angle	2 % of range

Measurement error is normally much less than error specified above.

Variation due to influence quantity is less than twice the error allowed for reference condition.

### Limit Switch (Relay):

Switching Voltage & Current for Relay	240 VDC ,5 A (1NO+1NC)
---------------------------------------	------------------------

### Influence of Variations:

Temperature coefficient :	
(for rated value range of use (0...50°C))	0.025%/°C for Voltage
0.05%/°C for Current	

### Display update rate:

Response time to step input	1 sec approx.
-----------------------------	---------------



# RISH Delta Energy / Demand (Multifunction instrument)

## Technical Specifications:

### Applicable Standards:

EMC	IEC 61326-1: 2005
Safety	IEC 61010-1-2001 , Permanently connected use
IP for water & dust	IEC60529

### Safety:

Pollution degree:	2
Installation category:	III
High Voltage Test	3.3 kV AC, 50Hz for 1 minute between Aux. and measuring inputs

### Environmental:

Operating temperature	0 to +50°C
Storage temperature	-25°C to +70°C
Relative humidity	0... 90% non condensing
Warm up time	Minimum 3 minute
Shock	15g in 3 planes
Vibration	10... 55 Hz, 0.15mm amplitude

### Enclosure:

Front	IP 50.
Front with seal (Option)	IP 65.
Back	IP 20.

### Dimensions and Weights:

Bezel size	96 mm x 96 mm DIN 43 718.
Panel cut-out	92 +0.8 mm x 92 + 0.8 mm.
Overall depth	55 mm.(without output option)
Panel Thickness	1 - 3 mm for self clicking, 1 – 6 mm for swivel screws.
Weight	320 gm. Approx.(with output option)

### Pulsed Output Option:

#### Energy (can be programmed for different energy parameters simultaneously):

Relay contact	(1NO+1NC)
Switching Voltage & current for Relay	240 VDC ,5 A

Default pulse rate divisor	1 per Wh (up to 3600W) ,	1 per kWh (up to 3600kWh) ,	1 per MWh (above 3600kW) ,
Other Pulse rate divisors (applicable only when Energy on RS485 is in <b>W</b> )			
10	1 per 10 Wh (up to 3600W) ,	1 per 10 kWh (up to 3600kWh) ,	1 per 10 MWh (above 3600kW) ,
100	1 per 100 Wh (up to 3600W) ,	1 per 100 kWh (up to 3600kWh) ,	1 per 100 MWh (above 3600kW) ,
1000	1 per 1000 Wh (up to 3600W) ,	1 per 1000 kWh (up to 3600kWh) ,	1 per 1000 MWh (above 3600kW) ,

Pulse Duration : 60 msec, 100 msec, 200 msec.

Above options are also applicable to Apparent and Reactive Energy.



# RISH Delta Energy / Demand (Multifunction instrument)

## Parameter measurement and Display:

Sr No	Parameter	3 Phase 4 Wire	3 Phase 3 Wire	1 Phase 2 Wire
1.	System Volts	✓	✓	✓
2.	System Current	✓	✓	✓
3.	Volts R-N (Phase Voltage for Single phase)	✓	✗	✓
4.	Volts Y-N	✓	✗	✗
5.	Volts B-N	✓	✗	✗
6.	Volts R-Y	✓	✓	✗
7.	Volts Y-B	✓	✓	✗
8.	Volts B-R	✓	✓	✗
9.	Current R (Phase Current for Single phase)	✓	✓	✓
10.	Current Y	✓	✓	✗
11.	Current B	✓	✓	✗
12.	Frequency	✓	✓	✓
13.	System Active Power (kW)	✓	✓	✓
14.	Active Power R (Phase Power for Single phase) (kW)	✓	✗	✓
15.	Active Power Y (kW)	✓	✗	✗
16.	Active Power B (kW)	✓	✗	✗
17.	System Re-active Power (kVAr)	✓	✓	✓
18.	Re-active Power R (Phase Power for Single phase) (kVAr)	✓	✗	✓
19.	Re-active Power Y (kVAr)	✓	✗	✗
20.	Re-active Power B (kVAr)	✓	✗	✗
21.	System Apparent Power (kVA)	✓	✓	✓
22.	Apparent Power R (Phase Power for Single phase) (kVA)	✓	✗	✓
23.	Apparent Power Y (kVA)	✓	✗	✗
24.	Apparent Power B (kVA)	✓	✗	✗
25.	System Phase Angle	✓	✓	✓
26.	System Power Factor	✓	✓	✓
27.	Power Factor R	✓	✗	✓
28.	Power Factor Y	✓	✗	✗
29.	Power Factor B	✓	✗	✗
30.	Phase Angle R	✓	✗	✓
31.	Phase Angle Y	✓	✗	✗
32.	Phase Angle B	✓	✗	✗
33.	Active Energy Import (kWh)	✓	✓	✓
34.	Active Energy Export (kWh)	✓	✓	✓
35.	Reactive Energy Import (kVArh)	✓	✓	✓
36.	Reactive Energy Export (kVArh)	✓	✓	✓
37.	Apparent Energy (kVAh)	✓	✓	✓
38.	RPM	✓	✓	✓
39.	Max (System Voltage / System Current)	✓	✓	✓
40.	Min (System Voltage / System Current)	✓	✓	✓
41.	Hour Run	✓	✓	✓
42.	ON Hour	✓	✓	✓
43.	Number of auxiliary interrupt	✓	✓	✓

✓ - Available ✗ - Not available



**RISHABH**  
INSTRUMENTS  
Measure, Control & Record with a Difference

RISHABH INSTRUMENTS PVT.LTD.  
F-31, MIDC, Satpur, Nashik-422 007, India.  
Tel.: +91 253 2202160, 2202202 Fax : +91 253 2351064  
E-mail : India :- marketing@rishabh.co.in  
International :- exp.marketing@rishabh.co.in  
www.rishabh.co.in

# RISH Delta Energy / Demand (Multifunction instrument)

## Parameter measurement and Display:

Sr No	Parameter	3 Phase 4 Wire	3 Phase 3 Wire	1 Phase 2 Wire
44	Current Demand	✓	✓	✓
45.	kVA Demand	✓	✓	✓
46	kW Demand Import	✓	✓	✓
47.	kW Demand Export	✓	✓	✓
48.	Max Current Demand	✓	✓	✓
49.	Max kVA Demand	✓	✓	✓
50.	Max kW Demand Import	✓	✓	✓
51	Max kW Demand Export	✓	✓	✓

✓ - Available \* - Not available

## Electrical Connections:

	Self Powered Aux	External Powered Aux
3 Phase 4 Wire Unbalanced Load		
3 Phase 3 Wire Unbalanced Load	Not Applicable	
1 Phase 2 Wire		

\*Note: For Measurement of parameters, Voltage must be present between terminal 2 & 11 for single phase or 3 phase 4 wire network and between terminal 2 & 5 or 2 & 8 for 3 phase 3 wire network.




**RISHABH**  
INSTRUMENTS  
Measure, Control & Record with a Difference

RISHABH INSTRUMENTS PVT.LTD.  
F-31, MIDC, Satpur, Nashik-422 007, India.  
Tel.: +91 253 2202160, 2202202 Fax : +91 253 2351064  
E-mail : India :- marketing@rishabh.co.in  
International :- exp.marketing@rishabh.co.in  
www.rishabh.co.in



# RISH Delta Energy / Demand (Multifunction instrument)

## Rear Connection

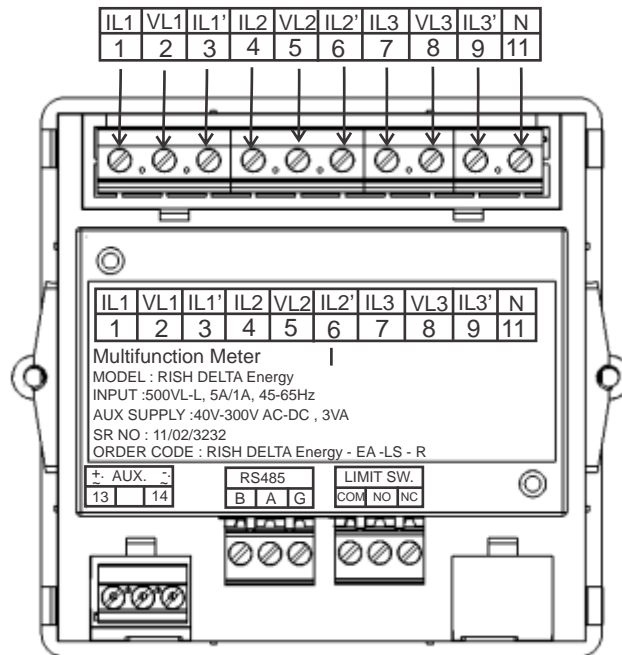


## Installation:

Easy Clip in Installation on Panel.

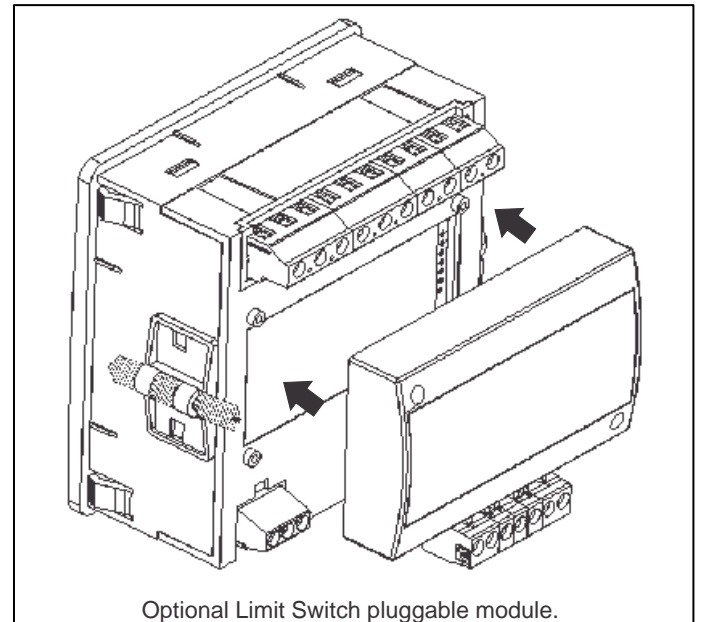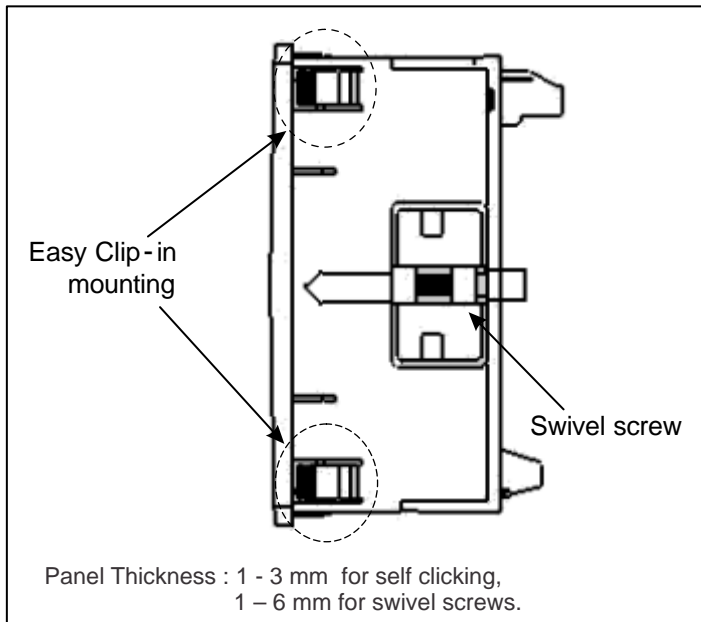

# RISH Delta Energy / Demand (Multifunction instrument)

## Dimension Details:

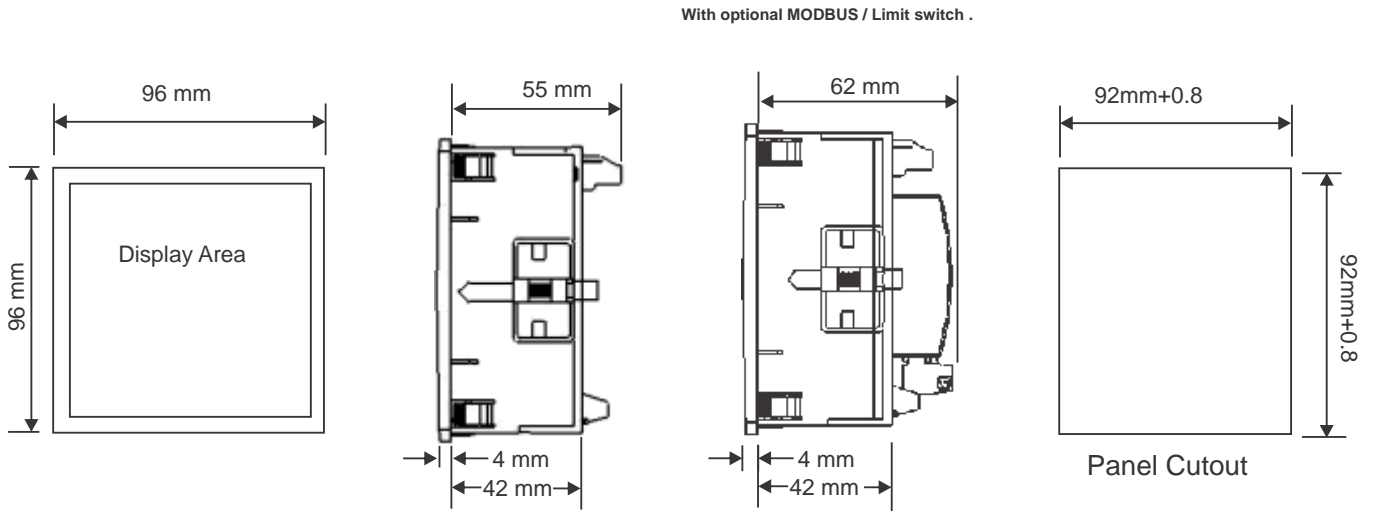

Ordering information	Ordering Code
	RISH Delta Energy
<b>Auxiliary Supply</b>	
Self Aux*	SA
<b>External Aux</b>	
40 V – 300V AC/DC	EA
<b>Pulse / Limit switch (Relay) - Optional</b>	
With Pulse output (Limit switch)	LS
Without Pulse output (Limit switch)	Z
<b>MODBUS (RS485) Output - Optional</b>	
MODBUS option not used	Z

### Order Code Example:

RISH Delta **Energy**– EA – LS - R

RISH Delta **Energy**, external aux (40V – 300V AC/DC), with limit switch, with MODBUS output.

**\*NOTE:** Self Auxiliary meter is available only in 3Phase 4 Wire and Single Phase network.

Auxiliary input is derived from Phase 1 (R phase).

In case of external auxiliary meter all three networks are available  
(3Phase 4Wire / 3Phase 3Wire / Single Phase)

Rishabh Instruments always tries for innovation and therefore product specifications are subject to change without notice



**RISHABH**  
INSTRUMENTS  
Measure, Control & Record with a Difference

RISHABH INSTRUMENTS PVT.LTD.  
F-31, MIDC, Satpur, Nashik-422 007, India.  
Tel.: +91 253 2202160, 2202202 Fax : +91 253 2351064  
E-mail : India :- marketing@rishabh.co.in  
International :- exp.marketing@rishabh.co.in  
www.rishabh.co.in